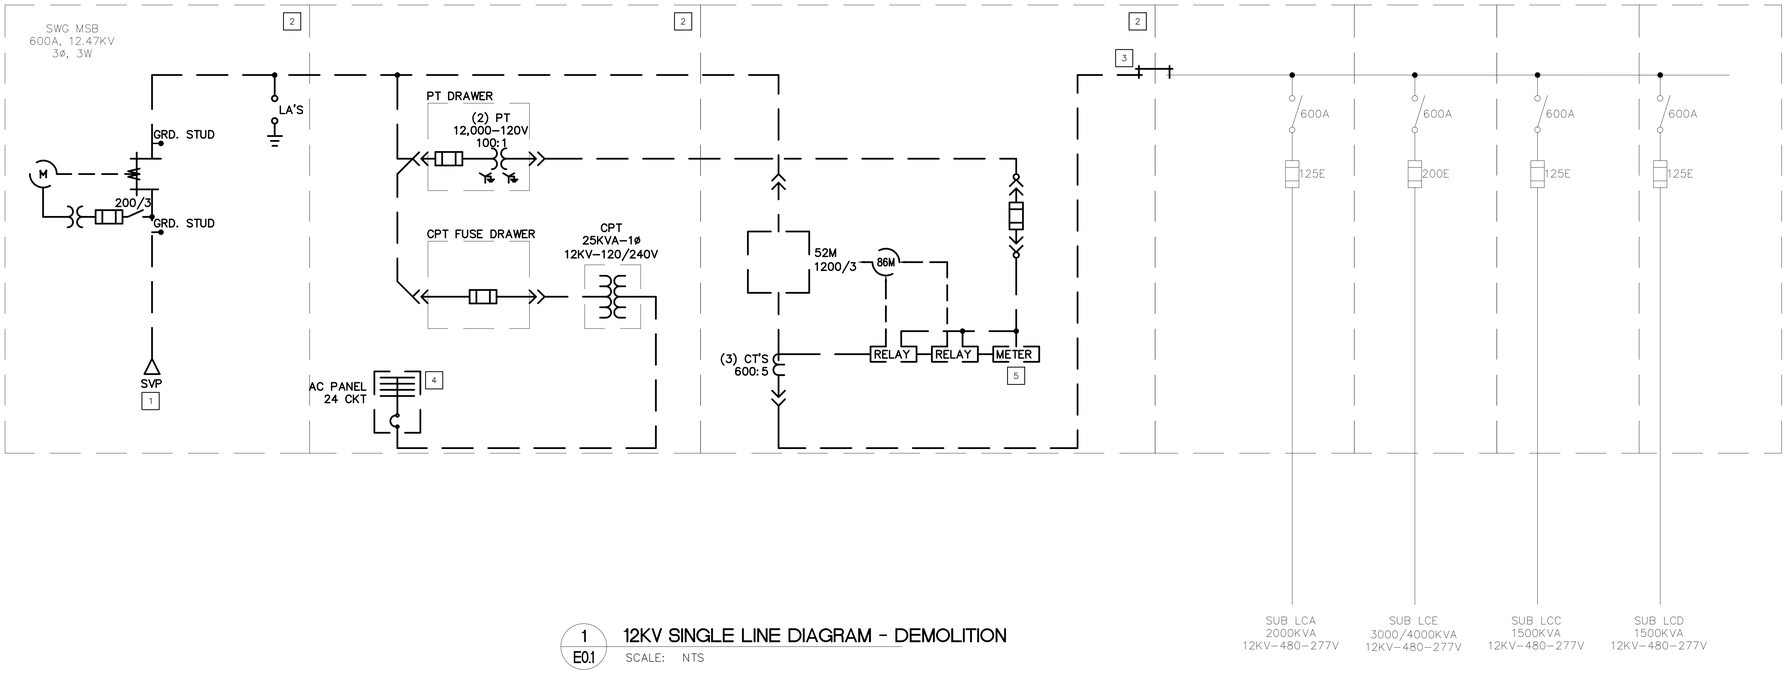

1 E0.1 **12KV SINGLE LINE DIAGRAM - DEMOLITION**

SCALE: NTS

2 E0.1 **12KV SINGLE LINE DIAGRAM - CONSTRUCTION**

SCALE: NTS

MSB 600A,12.47KV, 3PH, 3W, 25KAIC	FUSE	KVA	FLA
SUB LCA	125E	2000.0	92.0
SUB LCE	200E	4000.0	185.0
SUB LCD	125E	1500.0	69.0
SUB LCC	125E	1500.0	69.0
CONNECTED KVA:			9000.0
CONNECTED AMPS:			415
DEMANDED KVA:			6300
DEMANDED AMPS:			291